

# EPG SurePump™ Installation Record

EPG Job No. \_\_\_\_\_

**Installer's Name** \_\_\_\_\_

Address \_\_\_\_\_

City \_\_\_\_\_ State \_\_\_\_\_ Zip \_\_\_\_\_

Phone \_\_\_\_\_ Cell \_\_\_\_\_ Fax \_\_\_\_\_

Contact name \_\_\_\_\_

**Owner's Name** \_\_\_\_\_

Address \_\_\_\_\_

City \_\_\_\_\_ State \_\_\_\_\_ Zip \_\_\_\_\_

Phone \_\_\_\_\_ Cell \_\_\_\_\_ Fax \_\_\_\_\_

Contact name \_\_\_\_\_

Sump Name/ ID \_\_\_\_\_ Date Installed \_\_\_\_\_

Leachate or Condensate Temp \_\_\_\_\_ °F Or °C

**Pump:**

Model No. \_\_\_\_\_

Rating: \_\_\_\_\_ GPM@ \_\_\_\_\_ Ft. TDH

HP \_\_\_\_\_ Voltage \_\_\_\_\_ Phase \_\_\_\_\_

Actual Pump Delivery \_\_\_\_\_ GPM@ \_\_\_\_\_ PSI


Operating Cycle \_\_\_\_\_ ON (Min/Hr) \_\_\_\_\_ OFF (Min/Hr)

(Circle Min. or Hr. as appropriate)

**Sump or Tank Information:**

Height of Sump/Tank (A): \_\_\_\_\_ ft.

Inside Diameter (B): \_\_\_\_\_ ft.

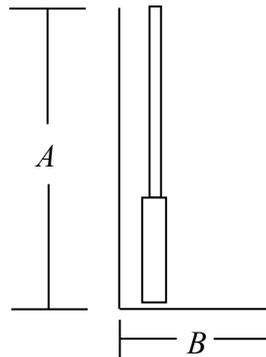


**Power Supply:**

Cable: Service Entrance to Control Distance \_\_\_\_\_ ft Wire Size \_\_\_\_\_ AWG/MCM

Copper \_\_\_\_\_ Jacketed \_\_\_\_\_ Aluminum \_\_\_\_\_ Individual conductors \_\_\_\_\_

Cable: Control to Motor \_\_\_\_\_ ft \_\_\_\_\_ AWG/MCM

Copper \_\_\_\_\_ Jacketed \_\_\_\_\_

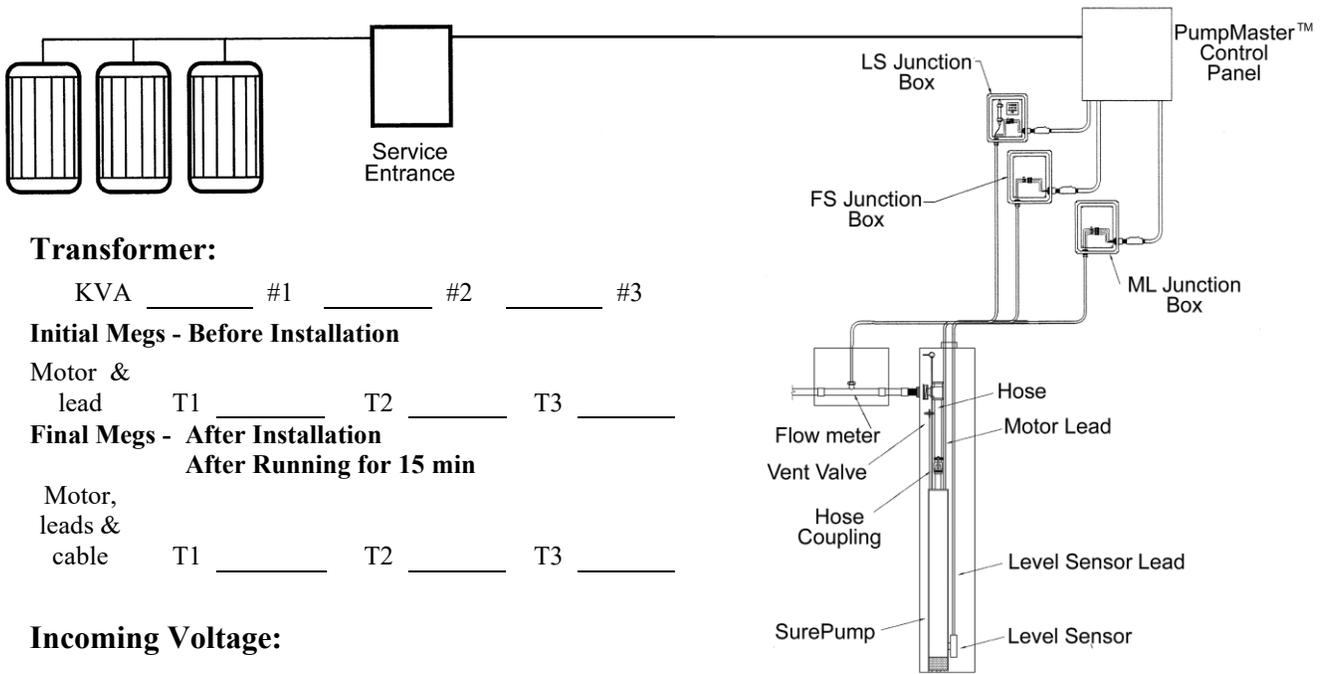

**Transformer:**

KVA \_\_\_\_\_ #1 \_\_\_\_\_ #2 \_\_\_\_\_ #3

**Initial Megs - Before Installation**

Motor & lead T1 \_\_\_\_\_ T2 \_\_\_\_\_ T3 \_\_\_\_\_

**Final Megs - After Installation  
After Running for 15 min**

Motor, leads & cable T1 \_\_\_\_\_ T2 \_\_\_\_\_ T3 \_\_\_\_\_

**Incoming Voltage:**

No Load L1-L2 \_\_\_\_\_ L2-L3 \_\_\_\_\_ L1-L3 \_\_\_\_\_

Full Load L1-L2 \_\_\_\_\_ L2-L3 \_\_\_\_\_ L1-L3 \_\_\_\_\_

**Running Amps:**

**Hookup:1**

Full Load L1 \_\_\_\_\_ L2 \_\_\_\_\_ L3 \_\_\_\_\_ % unbalanced \_\_\_\_\_

**Hookup:2**

Full Load L1 \_\_\_\_\_ L2 \_\_\_\_\_ L3 \_\_\_\_\_ % unbalanced \_\_\_\_\_

**Hookup:3**

Full Load L1 \_\_\_\_\_ L2 \_\_\_\_\_ L3 \_\_\_\_\_ % unbalanced \_\_\_\_\_

Ground wire size \_\_\_\_\_ AWG/MCM

DC Ground Current \_\_\_\_\_ mA Ground Test \_\_\_\_\_ Ohms

Motor Surge Protection \_\_\_\_\_ Yes \_\_\_\_\_ No

**Control Panel:**

Model # \_\_\_\_\_

**Short Circuit Device**

Circuit Breaker \_\_\_\_\_ Rating \_\_\_\_\_ Setting \_\_\_\_\_  
Fuses \_\_\_\_\_ Type \_\_\_\_\_ Rating \_\_\_\_\_  
\_\_\_\_\_ Standard \_\_\_\_\_ Time Delay \_\_\_\_\_

**Controls are Grounded to:**

\_\_\_\_\_ Motor  
\_\_\_\_\_ Rod  
\_\_\_\_\_ Power Supply

**Start Overloads:**

Name: \_\_\_\_\_

Set at \_\_\_\_\_ amps

Company \_\_\_\_\_

Date \_\_\_\_\_